

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110 001.

No. F.6/DFS/MS/School/2025/SZ/172

Dated: 18/02/2025

FIRE SAFETY CERTIFICATE

Certified that the **Adarsh Secondary School** located at D-Block, Vikas Puri, New Delhi-110018, comprised of basement (closed), ground plus one upper floor, owned/occupied by Adarsh Secondary School was issued Fire Safety Certificate by this department vide letter No F6/DFS/MS/School/2021/SZ/755 dated 16/09/2021. The school building was re-inspected by the officer concerned of this department on 07.02.2025, in the presence of Sh. S.K. Gupta (Manager) and found that the school management have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011 issued by the Director of Education and that the building/ premises **(ground and first floor only)** is fit for occupancy class "**Educational Building**" w.e.f. 18/02/2025 for a period of three years, subject to compliance of the conditions printed as under.

Issued on 18/02/2025 at New Delhi by.


 (Atul Garg)
 Director
 Delhi Fire Service

Copy to: -

1. Director of Education, GNCT of NCT of Delhi, Old Secretariat, New Delhi- 110054.
2. The Manager, Adarsh Secondary School Located at D-Block, Vikaspuri, New Delhi-18.
3. Executive Engineer (Bldg.), MCD, West Zone, Dr. Sahib Singh Varma Nigam Bhawan, Second Floor, Shivaji Enclave, New Delhi-110027: - for information regarding use of basement.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. Basement strictly shall be used as per BBL. Presently basement is closed.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/13

INSPECTION REPORT

1. Name & address of the building : Adarsh Secondary School, D-Block, Vikas Puri, New Delhi-110018
2. Building comprised of : Basement (closed), ground plus one upper floor only
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School/2021/SZ/755 dated 16.09.2021
6. Fire Safety directives letter No : Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011
7. Date of inspection : 07.02.2025
8. Name of Inspecting Officer : A.D.O. R.K. Yadav
9. Name and designation of officers
From the building side : Sh. S.K. Gupta (Manager)
10. Year of Construction : Before 2017
11. Applicant's letter No. : A.Sec.S/25/08 dated 22.01.2025

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Accessible 06 mtrs 4.5 mtrs N/A	12 mtrs 4.5 mtrs N/A	M/R MR N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	02 no.'s 02 no.'s	02 no.'s 02 no.'s	MR MR
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	150 cms	195 cms (02 no.'s)	MR
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	N/A	N/A	N/A
		N/A	N/A	N/A
	d. No. of continuous staircases to terrace	N/A	One	N/A
	e. Width of Corridor	150 cms.	170 cms	M/R
	f. Door Size	100 cms	105 & 100 cms few with single doors	M/R
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements 	Required	Exhaust fans are provided	M/R
	<ul style="list-style-type: none"> • Upper floors 	Required	Natural ventilation provided	M/R
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	09 no's ABC/CO ₂ type	Provided	M/R
			Provided	M/R
		ISI marked	Provided	M/R

N/14

6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	02 no's 30 m 05 mm	Provided Provided Provided	M/R M/R M/R
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8.	MOEFA			
9.	Public Address System			
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	Required N/A N/A	Provided N/A N/A	M/R N/A N/A
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A N/A	N/A N/A	N/A N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 450 LPM 40 mtrs N/A N/A	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A 450 LPM 40 mtrs Provided Provided	N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A N/A M/R M/R M/R M/R
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A N/A N/A N/A 5000 ltrs	N/A N/A N/A N/A 5000 ltrs	N/A N/A N/A N/A M/R, old case
15.	Exit Signage.			
		Required	Provided	M/R
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of Lift lobby Communication In lift Car Fireman's Grounding Switch Lift Signage 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A


N/LS

17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	> Total Area	N/A	N/A	N/A
	> Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

Note: - The shortcomings issued by this department vide letter No. F.6/DFS/MS/School/2024/SZ/568 dated 19.11.2024 have been rectified. As per undertaking given by the Manager of school (placed at C-21) that the basement of the building is permanently closed for all school activities (photo enclosed).

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter No. F.6/DFS/MS/School/2021/SZ/755 dated 16.09.2021, renewal in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.



 Signature of Inspecting Officer
 Name: - R.K. Yadav
 Designation: - ADO (JKP)

DO (South West)

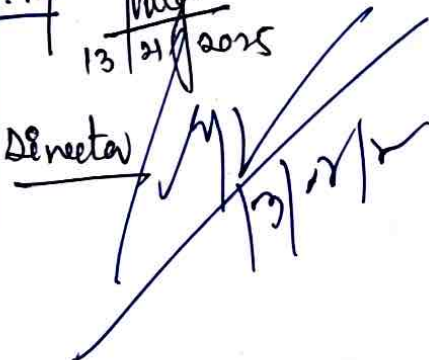


11/2/25




 13/2/2025

Director


 13/2/25

