



No. F6/DFS/MS/Collage/SZ/2026/04

Dated: 05/01/2026



FIRE SAFETY CERTIFICATE

Certified that the M/s Awadh Bhawan, at FC - 31, Sheikh Sarai - II, Press Enclave Road, New Delhi - 110017, comprised of Basement Ground plus three upper floor was issued earlier FSC vide letter No. F6/DFS/MS/2010/2010 dated 07/07/2010. Now the school building was re-inspected by the officer concerned of this department on 19/12/2025 in presence of Mr. Nittin Chaudhary and found that the building has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules 2010, Accordingly, the premises/ building comprised of Basement Ground plus three upper floors is fit for occupancy class "Educational Building" (Group-B) with effect from 05/01/2026 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010 is recommended.

Issued on 05/01/2026 at New Delhi by.


(A.K.Malik)
Dy. Chief Fire Officer
Delhi Fire Service
o/c @

Copy to: -

1. The Commissioner of Municipal Corporation of Delhi, Civic Center, New Delhi – 110002.
2. Mr. Nittin Chaudhary M/s Awadh Bhawan, at FC-31, Sheikh Sarai - II, Press Enclave Road, New Delhi - 110017.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

N/14

INSPECTION REPORT

01.	Name & address of the building	M/s Awadh Bhawan, at FC-31, Sheikh Sarai -II, Press Enclave Road, New Delhi-110017		
02.	Building is comprised of	Basement, ground plus three upper floor (Old Case)		
03.	Type of occupancy	"Educational" Building Class B		
04.	Type of case	Renewal		
05.	Details of previous FSC	F6/DFS/MS/2010/2010 dated 07/07/2010		
06.	Fire safety directives letter no.	F6/DFS/MS/BP/2000/1044 dated 16/06/2000		
07.	Date of inspection	19/12/2025.		
08.	Name of the inspecting officers	Yashwant Singh Meena ADO (BCP)		
09.	Name of the designation of officer from the building side	Mr. Nittin Chaudhary		
10.	Year of construction	2000		
11.	Applicant's letter no.	Outdoor Diary no. 8550 dated 20/11/2025		
S.No	Minimum standard of fire prevention and fire safety U/R	Directive Requirement	Provided at site	Remarks MR/NMR
01.	Access to Building:			
	A Road width	06 mtr	Provided	MR
	B Gate width	4.5 mtr	Provided	M/R
	C Width of internal road	N/A	N/A	N/A
02.	Number, Width, Type and Arrangement of Exits:			
	A Number of staircases			
	a Upper floor	02 nos.	Provided	MR
	B Basement	02 nos	Provided	M/R
	B Width of staircases			
	A Upper floor	1.50 m & 1.25 m	1.50 m & 1.25 m	MR
	b Basement	1.50 m & 1.25 m	1.50 m & 1.25 m	M/R
	C Protection of exits			
	a Fire check door	Required	Provided	M/R
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	02 no	Provided	MR
	E Width of corridor	Required	Provided	MR
	F Door size	02 nos.	1.25 m & 1.50 mtr.	MR
03.	Compartmentation:			
	A Fire check door	Required	Provided	MR
	B Sealing of electrical shafts	Required	Provided	MR
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
04.	Smoke Management System:			
	A Basement	12 a/c per hour	Provided	M/R
	B Upper floor	12 a/c per hour	Provided	M/R
05.	Fire Extinguisher:			
	A Total numbers	Required	Provided	MR
	B Types	ABC/CO ₂	ABC/CO ₂	MR
	C ISI marking	ISI Marked	ISI Marked	MR

3


06.	First-Aid-Hose Reel:				
	A	Total numbers of each floor	Required	Provided	MR
	B	Length of hose reel hose	30 m	Provided	MR
	C	Nozzle diameter	05 mm	Provided	MR
07.	Automatic Fire Detection and Alarming System:				
	A	Type of detectors	N/A	N/A	N/A
	B	Location of main panel	N/A	N/A	N/A
	C	Location of repeater panel	N/A	N/A	N/A
	D	Alternate source of power	N/A	N/A	N/A
	E	Hooters	N/A	N/A	N/A
08.	MOEFA:		Required	Provided	MR
09.	Public Address System:				
10.	Automatic Sprinkler System:				
	A	Basement	Required	Provided	MR
	B	Upper floor & Ground	N/A	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants:				
	A	Size of riser/down-comer	100mm	Provided	M/R
	B	Number of hydrants per floor	02 no	Provided	M/R
	C	Hose box	02 no	Provided	M/R
12.	Yard Hydrants:				
	A	Total number of hydrants	N/A	N/A	N/A
	B	Hose box	N/A	N/A	N/A
13.	Pumping Arrangements:				
1	Ground level				
	A	Discharge of main pump	N/A	N/A	N/A
	B	Head of main pump	N/A	N/A	N/A
	C	Number of main pumps	N/A	N/A	N/A
	D	Jockey pump out put	N/A	N/A	N/A
	E	Jockey pump head	N/A	N/A	N/A
	F	Standby pump out put	N/A	N/A	N/A
	G	Standby pump head	N/A	N/A	N/A
	H	Auto starting /manual stopping	N/A	N/A	N/A
	I	Pump house access	N/A	N/A	N/A
2	Terrace Level				
	A	Discharge of pump	900 LPM	Provided	MR
	B	Head of the pump	30 m	Provided	MR
	C	Power supply	Required	Provided	MR
	D	Auto starting of pump	Required	Provided	MR
14.	Captive Water Storage for Fire Fighting:				
	A	Underground tank capacity	1,00,000 ltrs	Provided	M/R
	B	Draw-off connection	Required	Provided	MR
	C	Fire service inlet	Required	Provided	MR
	D	Access to tank	Required	Provided	MR
	E	Overhead tank capacity	20,000 ltrs	Provided	MR

r/113

15. Exit Signage:		Required	Provided	MR
16. Provision of Lifts:				
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	N/A	N/A
17. Standby Power Supply:		Required	Provided	MR
18. Refuge Area:				
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
19. Fire Control Room:				
A	Detector system panel	Required	Provided	MR
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	Required	Provided	MR
E	Building floor plans	Required	Provided	MR
20. Special Fire Protection systems for protection of special Risks, if any:		NA	N/A	N/A

The fire protection system was randomly checked and tested and was found functional at the time of inspection. the shortcoming issued vide letter no. F6/DFS/MS/2025/Collage/117 dated 29/09/2025 has been complied.

Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the Rules the Fire Safety Certificate issued vide letter no. F6/DFS/MS/2010/2010 dated 07/07/2010. under Rule 37 of the Delhi Fire Service Rules,2010 is recommended.


 22/12/2025

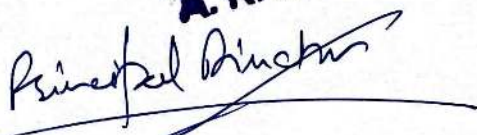
Signature of the Inspecting Officer
 Name: - Yashwant Singh Meena
 Designation: - ADO/BCP

DO/SD



 20/12/25

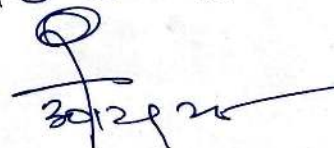



 20/12/25
A.K. MALIK


 Principal Director

Dy. CFO to J.S.M.


 31/12/25
A.K. MALIK
 Dy. CFO (SZ)


 30/12/25