



No. F6/DFS/MS/School/ SZ/2026/ 23

Dated: 18/02/2026

FIRE SAFETY CERTIFICATE

Certified that the Deep Public School located at Sector - D, Pocket-II Vasant Kunj, New Delhi – 110070, building comprised of Basement, Ground plus three upper floors only have complied with the Fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of this department on 12/02/2026 in the presence of Sh. Waseem Anwar Tak – Junior Engineer (MCD) and found that the building premises is fit for occupancy class Educational Building, Group - B (School) with effect from 18/02/2026 for a period of three years in accordance with Rule 35 unless renewed under Rule 37 of sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010 and also conditions printed below.

Issued on 18/02/2026 at New Delhi by.

M. K Chattopadhyay
Dy. Chief Fire Officer
Delhi Fire Service

Copy to :

1. The Commissioner, MCD, Civic Center, New Delhi, w.r.t Online Id -10121635 dated 04/02/26.
2. The Director of Education, Govt of NCT of Delhi, Old Secretariat, Delhi – 110054.
3. The Principal, Deep Public School, Sector - D, Pocket-II Vasant Kunj, New Delhi – 110070.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards lift installation, electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. Basement shall be used as per UBBL.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

H) 24

INSPECTION REPORT

01.	Name & address of the building	Deep Public School, Sector - D, Pocket-II Vasant Kunj, New Delhi - 110070.		
02.	Building is comprised of	Basement, Ground plus Three upper floors		
03.	Type of occupancy	Educational Building, Group - B (School)		
04.	Type of case	New case Additional/Alteration		
05.	Details of previous FSC	F6/DFS/MS/School/2018/SZ/74 dated 10/01/2018 for old building comprised Basement, Ground, plus two upper floor		
06.	Fire safety directives letter no.	F6/DFS/MS/2020/BP/School/369 dated 25/09/2020		
07.	Date of inspection	12.02.2026		
08.	Name of the inspecting officers	Ravinder Singh DO/SD Yashwant Singh Meena ADO/BCP		
09.	Name of the designation of officer from the building side	Waseem Anwar Tak – Junior Engineer (MCD)		
10.	Year of construction	1999/ 2020		
11.	Applicant's letter no.	Online Application no. 10121635 dated 04/02/2026		
S.No	Minimum standard of fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
01.	Access to Building:			
	A Road width	06 mtrs	18 meters	MR
	B Gate width	05 mtrs	5 meters	MR
	C Width of internal road	N/A	N/A	N/A
02.	Number, Width, Type and Arrangement of Exits:			
	A Number of staircases			
	a Upper floor	02 nos.	03 nos.	MR
	C Basement	02 nos.	03 nos.	MR
	B Width of staircases			
	a Upper floor	1.50 m each	Provided	MR
	C Basement	1.50 m each	Provided	MR
	C Protection of exits			
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	02 nos.	02 nos.	MR
	E Width of corridor	N/A	N/A	N/A
	F Door size	1.20 m	Provided	MR
03.	Compartmentation:			
	A Fire check door	N/A	N/A	N/A
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
04.	Smoke Management System:			
	A Basement	Required	Provided	MR
	B Upper floor	Required	Naturally ventilated	MR
05.	Fire Extinguisher:			
	A Total numbers	15 nos	15 nos.	MR
	B Types	ABC/CO ₂	ABC/CO ₂ - 15	MR
	C ISI marking	ISI Marked	Provided	MR

W

N/ 25

06.	First-Aid-Hose Reel:			
	A	Total numbers of each floor	Two	MR
	B	Length of hose reel hose	30 m	MR
	C	Nozzle diameter	5mm	MR
07.	Automatic Fire Detection and Alarming System:			
	A	Type of detectors	N/A	N/A
	B	Location of main panel	N/A	N/A
	C	Location of repeater panel	N/A	N/A
	D	Alternate source of power	N/A	N/A
	E	Hooters	N/A	N/A
08.	MOEFA:		N/A	Provided
09	Public Address System:		N/A	Provided
10.	Automatic Sprinkler System:			
	A	Basement	Required	Provided
	B	Upper floor	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A
11.	Internal Hydrants:			
	A	Size of riser/down-comer	N/A	Provided
	B	Number of hydrants per floor	N/A	Provided
	C	Hose box	N/A	Provided
12.	Yard Hydrants:			
	A	Total number of hydrants	N/A	N/A
	B	Hose box	N/A	N/A
13.	Pumping Arrangements:			
1	Ground level			
	A	Discharge of main pump	2280 LPM	Provided
	B	Head of main pump	70 m	Provided
	C	Number of main pumps	01 nos	Provided
	D	Jockey pump out put	180 LPM	Provided
	E	Jockey pump head	70 m	Provided
	F	Standby pump out put	2280 LPM	Provided
	G	Standby pump head	70 m	Provided
	H	Auto starting /manual stopping	Required	Provided
	I	Pump house access	Required	Provided
2	Terrace Level			
	A	Discharge of pump	900 LPM	Provided
	B	Head of the pump	70 m	Provided
	C	Power supply	Required	Provided
	D	Auto starting of pump	Required	Provided

14.	Captive Water Storage for Fire Fighting:			
	A	Underground tank capacity	2,00,000 ltrs	Provided
	B	Draw-off connection	Required	Provided
	C	Fire service inlet	Required	Provided
	D	Access to tank	Required	Provided
	E	Overhead tank capacity	15,000 liters	Provided
			Required	Provided
15.	Exit Signage:			
16.	Provision of Lifts: (No lift is installed at this time of inspection)			
	A	Pressurization of lift shaft	N/A	N/A
	B	Pressurization of lift lobby	N/A	N/A
	C	Communication in lift car	N/A	N/A
	D	Firemen's grounding switch	N/A	N/A
	E	Lift signage	N/A	N/A


2


17.	Standby Power Supply:	Required	Provided	MR
18.	Refuge Area:			
	A Total area	N/A	N/A	N/A
	B Location	N/A	N/A	N/A
19.	Fire Control Room:			
	A Detector system panel	N/A	N/A	N/A
	B Flow switch panel	N/A	N/A	N/A
	C PA system panel	N/A	N/A	N/A
	D Battery backup	N/A	N/A	N/A
	E Building floor plans	N/A	N/A	N/A
20.	Special Fire Protection systems for protection of special Risks, if any:	NA	N/A	N/A

The fire protection system provided in the building were checked tested at random and found functional at the time of inspection.


Keeping in view of the substantial compliance of the minimum standards of fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.

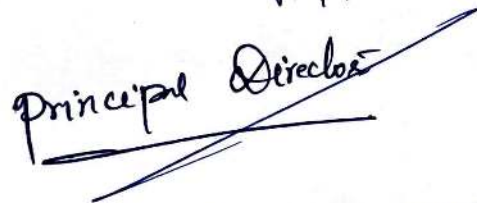
Last Date: 18/02/2026.


 Signature of the Inspecting Officer
 Name: Ravinder Singh
 Designation: DO /SD


 Signature of the Inspecting Officer
 Name: Yashwant Singh Meena
 Designation: ADO /BCP




 17/2/2026


 Principle Director

My. CFA to Comm.

 18/02/26

My. CFA (SRT)



 18/2

put up F.T.

DO(SD)