




No. F6/DFS/MS/School/SZ/2025/1405

Dated: 19/12/2025

FIRE SAFETY CERTIFICATE

Certified that the Govt. Girls Sr. Sec. School (Morning shift) ID 1925049 & Govt. Boys Sr. Sec. School (Evening shift) ID 1925052, New SPS (semi pucca structure) located at Jogabai Batala House, Okhla, New Delhi -25, Building ID no. 19251948, comprised of 02 Blocks : Ground + 3 upper floor (1st block) & Ground + 3 upper floors (2nd block) each block are interconnected at all floors level, was earlier issued FSC vide letter no. F6/DFS/MS/School/2022/SZ/1191 dated 25/10/2022. Now, the school building was re-inspected by the officer concerned of this department on 06/12/2025 in the presence of Ms. Usha Kiran (Principal) and found that the school has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. Accordingly, the premises/building comprised of 2 blocks (Ground + 3 upper floors each block) is fit for occupancy class **(Group - B) "Educational Building"** with effect from 19/12/2025 for a period of **three years** in accordance with Rule 36 unless renewal under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the DFS Rules, 2010 is recommended.

Issued on 19/12/2025 at New Delhi by.


(A.K. Malik)
Dy. Chief Fire Officer
Delhi Fire Service
o/c @

Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, old Secretariat, New Delhi-110054.
2. The Principal, Govt. Girls Sr. Sec. School (Morning Shift), New SPS (Semi Pucca Structure) located at Jogabai, Batla House, Okhla, New Delhi-25, School ID no. 1925049.
3. The Principal, Govt. Boys Sr. Sec. School (Evening Shift), New SPS (Semi Pucca Structure) located at Jogabai, Batla House, Okhla, New Delhi-25, School ID no. 1925052.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

- 119 -

INSPECTION REPORT

01.	Name & address of the building	Govt. Girls Sr. Sec. School (Morning shift) ID 1925049 & Govt. Boys Sr. Sec. School (Evening shift) ID 1925052, New SPS (semi pucca structure) located at Jogabai Batala House, Okhla, New Delhi -25, Building ID no. 19251948,		
02.	Building is comprised of	Comprised of 02 Blocks : 1 st block: G+3 upper floors 2 nd block: G+3 upper floors Each block Interconnected at all floors level		
03.	Type of occupancy	Educational Building Group -B		
04.	Type of case	Renewal		
05.	Details of previous FSC	F6/DFS/MS/School/2022/SZ/1191 dated 25/10/2022.		
06.	Fire safety directives letter no.	NBC Part -IV & UBBL 2016		
07.	Date of inspection	06.12.2025.		
08.	Name of the inspecting officers	Yashwant Singh Meena ADO (BCP)		
09.	Name of the designation of officer from the building side	Ms. Usha Kiran (Principal)		
10.	Year of construction	2018-19		
11.	Applicant's letter no.	Outdoor dairy no. 8320 dated 17/11/2025		
S.No	Minimum standard of fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR

01.	Access to Building:				
	A	Road width	6.0 mtrs	6.0 mtrs.	MR
	B	Gate width	N/A	N/A	N/A
	C	Width of internal road	N/A	N/A	N/A

02.	Number, Width, Type and Arrangement of Exits:				
	A	Number of staircases	(Each block interconnected at all floors level)		
	a	Upper floor	1 st block -2 nos. 2 nd block-1 nos.	1 st block -2 nos. 2 nd block-1 nos.	MR
	C	Basement	N/A	N/A	N/A
	B	Width of staircases			
	a	Upper floor	1.5 mtrs. each block	1.7 mtrs. each block	MR
	C	Basement	N/A	N/A	N/A
	C	Protection of exits			
	a	Fire check door	N/A	N/A	N/A
	b	Pressurization	N/A	N/A	N/A
	D	No. of continuous staircases to terrace	03 nos.	03 nos.	MR
	E	Width of corridor	1.5 mtrs	1.6 mtrs	MR
	F	Door size	1.0 mtr. (for class room)	1.0 mtr. (for class room)	MR

03.	Compartmentation:				
	A	Fire check door	N/A	N/A	N/A
	B	Sealing of electrical shafts	N/A	N/A	N/A
	C	Fire rating of shaft door	N/A	N/A	N/A
	D	Water curtain	N/A	N/A	N/A
	E	Fire dampers	N/A	N/A	N/A

04.	Smoke Management System:				
	A	Basement	N/A	N/A	N/A
	B	Upper floor	N/A	N/A	N/A


- 2/20 -

05. Fire Extinguisher:					
	A	Total numbers	20 nos.	70 nos.	MR
	B	Types	ABC/CO ₂	ABC/CO ₂	MR
	C	ISI marking	ISI Marked	ISI Marked	MR
06. First-Aid-Hose Reel:					
	A	Total numbers of each floor	1 st block -4 nos. 2 nd block-2 nos.	1 st block -4 nos. 2 nd block-2 nos	MR
	B	Length of hose reel hose	30 m	Provided	MR
	C	Nozzle diameter	05 mm	Provided	MR
07. Automatic Fire Detection and Alarming System:					
	A	Type of detectors	N/A	N/A	N/A
	B	Location of main panel	N/A	N/A	N/A
	C	Location of repeater panel	N/A	N/A	N/A
	D	Alternate source of power	N/A	N/A	N/A
	E	Hooters	N/A	N/A	N/A
08. MOEFA:			N/A	N/A	N/A
09. Public Address System:			N/A	Provided	N/A
10. Automatic Sprinkler System:					
	A	Basement	N/A	N/A	N/A
	B	Upper floor	N/A	N/A	N/A
	C	Sprinkler above false ceiling	N/A	N/A	N/A
11. Internal Hydrants:					
	A	Size of riser/down-comer	N/A	N/A	N/A
	B	Number of hydrants per floor	N/A	N/A	N/A
	C	Hose box	N/A	N/A	N/A
12. Yard Hydrants:					
	A	Total number of hydrants	N/A	N/A	N/A
	B	Hose box	N/A	N/A	N/A
13. Pumping Arrangements:					
1 Ground level					
	A	Discharge of main pump	N/A	N/A	N/A
	B	Head of main pump	N/A	N/A	N/A
	C	Number of main pumps	N/A	N/A	N/A
	D	Jockey pump out put	N/A	N/A	N/A
	E	Jockey pump head	N/A	N/A	N/A
	F	Standby pump out put	N/A	N/A	N/A
	G	Standby pump head	N/A	N/A	N/A
	H	Auto starting /manual stopping	N/A	N/A	N/A
	I	Pump house access	N/A	N/A	N/A
2 Terrace Level					
	A	Discharge of pump	450 LPM	2 nos. of 450 LPM	MR
	B	Head of the pump	40 mtrs. each	40 mtrs. each	MR
	C	Power supply	Required	Provided	MR
	D	Auto starting of pump	Required	Provided	MR
14. Captive Water Storage for Fire Fighting:					
	A	Underground tank capacity	N/A	N/A	N/A
	B	Draw-off connection	N/A	N/A	N/A
	C	Fire service inlet	N/A	N/A	N/A
	D	Access to tank	N/A	N/A	N/A
	E	Overhead tank capacity	10,000 ltrs	10,000 ltrs	MR

15. Exit Signage:		Required	Provided	MR
16. Provision of Lifts:				
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	N/A	N/A
17. Standby Power Supply:		NA	N/A	N/A
18. Refuge Area:				
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
19. Fire Control Room:				
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
20. Special Fire Protection systems for protection of special Risks, if any:		NA	N/A	N/A


The fire protection system was randomly checked and tested and was found functional at the time of inspection.


Keeping in view of the deemed compliance of minimum standards on fire prevention and fire safety measures as required under the Rules the Fire Safety Certificate issued vide letter no F6/DFS/MS/School/2022/SZ/1191 dated 25/10/2022 under Rule 37 of the Delhi Fire Service Rules,2010 is **recommended**.

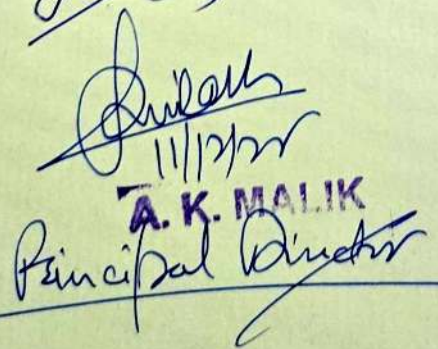

9/12/2025

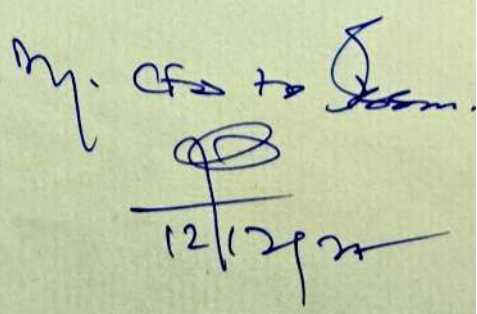
Signature of the Inspecting Officer
Name: - Yashwant Singh Meena
Designation: - ADO/BCP

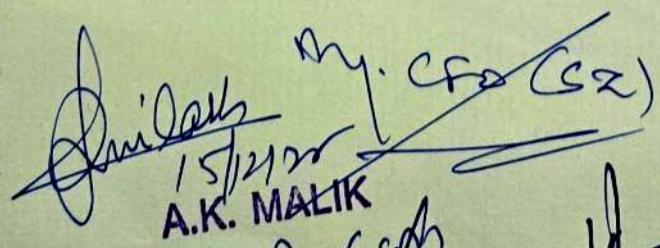
DO/SD

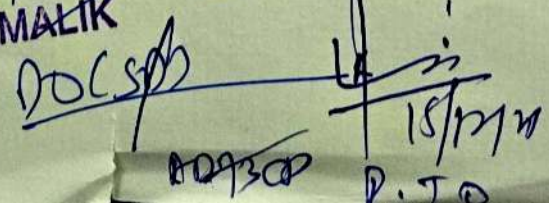

Ravinder Singh
10/12/22


Dy. CFO (SZ)


A.K. MALIK
Principal Director


my. CFO to J. ...
12/12/22


my. CFO (SZ)
A.K. MALIK
15/12/22


DOC/SB
15/12/22
P.T.O