



No. F6/DFS/MS/School/SZ/2025/1404

Dated: 19/12/2025

FIRE SAFETY CERTIFICATE

Certified that the Homely Ideal Public School, H-16/200/76, Sangam Vihar, New Delhi 110080, comprised of Two blocks, 1st block G+1 & 2nd block B+G, But School running at Ground floor only Basement is sealed, was earlier issued earlier FSC vide letter No. F6/DFS/MS/School/2018/SZ/724 dated 17/04/2018. Now the school building was re-inspected by the officer concerned of this department on 05/12/2025 in presence of Mr. RS Sethi (Manager) and overseed that all the Fire Prevention and Fire Safety arrangement provided found in good working condition. The premises have therefore deemed complied with the fire prevention and fire safety requirements dated 01/03/2011 issued by Director of Education Govt of NCT of Delhi and that the building / premises is fit for occupancy class "Educational Building" (Group-B)" School running at Ground floor only with effect from 19/12/2025 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010.

Issued on 19/12/2025 at New Delhi by.


(A.K. Malik)
Dy. Chief Fire Officer
Delhi Fire Service
o/c (6)

Copy to: -

1. The Director of Education, Govt of NCT of Delhi, Old Secretariat, Delhi – 110054.
2. The Principal, Homely Ideal Public School, H-16/200/76, Sangam Vihar, New Delhi 110080.

Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment's and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the firefighting equipment's shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc. may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & address of the building	Homely Ideal Public School, H-16/200/76, Sangam Vihar, New Delh110080		
2	Building is comprised of	Two blocks, 1 st block G+1 & 2 nd block B+G		
3	Type of occupancy	Educational Building (Group -B)		
4	Type of case	Renewal Case		
5	Details of previous FSC	F6/DFS/MS/School/2018/SZ/724 dated 17/04/2018		
6	Fire safety directives letter no.	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01/03/2018		
7	Date of inspection	05/12/2025		
8	Name of the inspecting officers	Yashwant Singh Meena, ADO/Mathura Road		
9	Name of the designation of officer from the building side	Mr. RS Sethi (Manager)		
10	Year of construction	2013 (School building is compromised of 2 blocks. 1 st block is compromised of ground plus first floor where school is running at ground floor only and second block is compromised of basement(sealed) and ground floor, where school is running at ground floor.)		
11	Applicant's letter no.	Outdoor Diary No. 7941 dated 07/11/2025		
S.No	Minimum standard of fire prevention and fire safety U/R 33	Old NOC Requirement	Provided at site	Remarks MR/NMR
1	Access to Building:			
	A Road width	Required	6.0 meters.	MR
	B Gate width	N/A	4.0 meters.	N/A
	C Width of internal road	N/A	N/A	N/A
2	Number, Width, Type and Arrangement of Exits:			
	A Number of staircases			
	a Upper floor	N/A	School at GF only	N/A
	b Basement	N/A	N/A	N/A
	B Width of staircases		N/A	N/A
	a Upper floor	N/A	N/A	N/A
	b Basement	N/A	N/A	N/A
	C Protection of exits		N/A	N/A
	a Fire check door	N/A	N/A	N/A
	b Pressurization	N/A	N/A	N/A
	D No. of continuous staircases to terrace	N/A	N/A	N/A
	E Width of corridor	N/A	N/A	N/A
	F Door size	1.0 meters.	Provided	MR
3	Compartmentation:			
	A Fire check door	NA	NA	NA
	B Sealing of electrical shafts	N/A	N/A	N/A
	C Fire rating of shaft door	N/A	N/A	N/A
	D Water curtain	N/A	N/A	N/A
	E Fire dampers	N/A	N/A	N/A
4	Smoke Management System:			
	A Basement	30 ACPH	N/A	N/A
	B Upper floor	12 ACPH	N/A	N/A

2/12


5. Fire Extinguisher:				
A	Total numbers	Required.	09 No's.	MR
B	Types	CO ₂ & ABC	ABC Type	MR
C	ISI marking	Required	Provided	MR
6 First-Aid-Hose Reel:				
A	Total numbers of each floor	N/A	N/A	N/A
B	Length of hose reel hose	N/A	N/A	N/A
C	Nozzle diameter	N/A	N/A	N/A
7 Automatic Fire Detection and Alarming System:				
A	Type of detectors	N/A	N/A	N/A
B	Location of main panel	N/A	N/A	N/A
C	Location of repeater panel	N/A	N/A	N/A
D	Alternate source of power	N/A	N/A	N/A
E	Hooters	N/A	N/A	N/A
8	MOEFA:	N/A	N/A	N/A
9	Public Address System:	N/A	N/A	N/A
10 Automatic Sprinkler System:				
A	Basement	N/A	N/A	N/A
B	Upper floor	N/A	N/A	N/A
C	Sprinkler above false ceiling	N/A	N/A	N/A
11 Internal Hydrants:				
A	Size of riser/down-comer	N/A	N/A	N/A
B	Number of hydrants per floor	N/A	N/A	N/A
C	Hose box	N/A	N/A	N/A
12 Yard Hydrants:				
A	Total number of hydrants	N/A	N/A	N/A
B	Hose box	N/A	N/A	N/A
13 Pumping Arrangements:				
1 Ground level				
A	Discharge of main pump	N/A	N/A	N/A
B	Head of main pump	N/A	N/A	N/A
C	Number of main pumps	N/A	N/A	N/A
D	Jockey pump out put	N/A	N/A	N/A
E	Jockey pump head	N/A	N/A	N/A
F	Standby pump out put	N/A	N/A	N/A
G	Standby pump head	N/A	N/A	N/A
H	Auto starting /manual stopping	N/A	N/A	N/A
I	Pump house access	N/A	N/A	N/A
2 Terrace Level				
A	Discharge of pump	N/A	N/A	N/A
B	Head of the pump	N/A	N/A	N/A
C	Power supply	N/A	N/A	N/A
D	Auto starting of pump	N/A	N/A	N/A
14 Captive Water Storage for Fire Fighting:				
A	Underground tank capacity	N/A	N/A	N/A
B	Draw-off connection	N/A	N/A	N/A
C	Fire service inlet	N/A	N/A	N/A
D	Access to tank	N/A	N/A	N/A
E	Overhead tank capacity	N/A	N/A	N/A

3

15	Exit Signage:	N/A	N/A	N/A	
16	Provision of Lifts:				
	A	Pressurization of lift shaft	N/A	N/A	N/A
	B	Pressurization of lift lobby	N/A	N/A	N/A
	C	Communication in lift car	N/A	N/A	N/A
	D	Firemen's grounding switch	N/A	N/A	N/A
	E	Lift signage	N/A	N/A	N/A
17	Standby Power Supply:	N/A	N/A	N/A	
18	Refuge Area:				
	A	Total area	N/A	N/A	N/A
	B	Location	N/A	N/A	N/A
19	Fire Control Room:				
	A	Detector system panel	N/A	N/A	N/A
	B	Flow switch panel	N/A	N/A	N/A
	C	PA system panel	N/A	N/A	N/A
	D	Battery backup	N/A	N/A	N/A
	E	Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A	

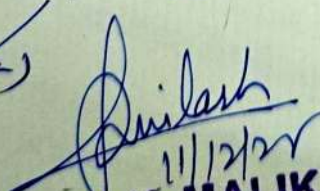
The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.

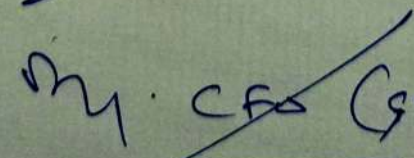
Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter F6/DFS/MS/School/2018/SZ/724 dated 17/04/2018, renewal under Rule 37 of the Delhi Fire Service rules 2010, is recommended.


 Signature of the Inspecting Officer
 Name Yashwant Singh Meena
 Designation ADO/Mathura Road


D.O/SD


 Ravinder Singh


 11/12/20
 A.K. MALIK
 Principal Director


 15/12/20
 A.K. MALIK

My. CFO to Insp.


 12/12/20