



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

No.F6/DFS/MS/School/SZ/2025/ 841

Dated: 30/06/2025

also  
7/5  
आशादीन  
अमृत महोत्सव

**FIRE SAFETY CERTIFICATE**

Certified that the **J.N. International School** (Earlier known as National Rajdhani Public School) located at Ekta Vihar, Jaitpur, Badarpur, New Delhi – 110044, comprised of Ground + 03 upper floors (**School operational at Ground + 01 upper floor only**) was granted Fire Safety Certificate by this department vide letter no.- F6/DFS/MS/School/2018/SZ/254 dated 0.12.2018. The School Building was re-inspected by Assistant Divisional Officer (M. Road) from this department on 26.06.2025 in the presence of Mr. Anil Lumbardar (Manager) and found that the School Building has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. Accordingly, the premises is fit for occupancy of **“Group B ‘Educational Building”** with effect from 30/06/2025..... for a period of Three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire Service Rules, 2010 printed below.

Issued on 30/06/2025 at New Delhi by.

(Atul Garg)  
Director

Delhi Fire Service

**Copy to:-**

1. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, Delhi.
2. The Principal, J. N. International School, Ekta Vihar, Jaitpur, Badarpur, New Delhi – 110044 , New Delhi.

**Conditions for the validity of Fire Safety Certificate:-**

1. This FSC is valid for Ground + 01 upper floors only.
2. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
3. All the means of escape shall be kept free of all the type of obstruction all the time.
4. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
5. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
6. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
7. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
8. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1	Name & address of the building	J. N. International School, Ekta Vihar, Jaitpur, Badarpur, New Delhi - 110044.			
2	Building is comprised of	Ground + 03 upper floors. School running at Ground + 01 upper floor only.			
3	Type of occupancy	Group B - Educational (School)			
4	Type of case	Renewal			
5	Details of previous FSC	F6/DFS/MS/School/2018/SZ/254 dated 15.02.2018			
6	Fire safety directive letter no.	UBBL/NBC-2016			
7	Date of inspection	26.06.2025			
8	Name of the inspecting officers	Rajesh Kumar Shukla, ADO (M. Road)			
9	Name of the designation of officer From the building side	Mr. Anil Lumbardar (Manager)			
10	Year of construction	2018			
11	Applicant's letter no.	Letter bearing outdoor diary no. 2054 dated 23.05.2025			
S. No	Minimum standard of Fire Prevention and Fire Safety U/R 33	Requirement as per Rule 35 (6)	Provide at site	Remarks MR/NMR	
1	<b>Access to Building</b>				
	A	Road width	Accessibility	Provided	MR(old case)
	B	Gate width	NA	NA	NA
	C	Width of internal roads	NA	NA	NA
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>				
	A	<b>No. of staircase:</b>			
		a) Upper floor	02 nos.	02 nos.	MR
		b) Basements	02 nos.	02 nos.	MR
	B	<b>Width of the staircase:</b>			
		a) Upper floors	1.50 m (Single) but If main staircase is < 1.5 m then an alternate staircase of min. 75 cms is required	1.48 m and 1.28 m	MR
		b) Basements	NA	NA	NA
	C	<b>Protection of exits</b>			
		a) Fire check door	NA	NA	NA
		b) Pressurization	NA	NA	NA
	D	No. of continuous staircase to terrace:	Required	Provided	MR
	E	Width of the corridor	NA	NA	NA
	F	Door size	1.0 m for class room	Provided	MR
3	<b>Compartmentation:</b>				
	A	Fire check doors	NA	NA	NA
	B	Sealing of horizontal & vertical opening	NA	NA	NA
	C	Fire rating of shaft doors	NA	NA	NA
	D	Water curtain	NA	NA	NA
	E	Fire dampers	NA	NA	NA
4	<b>Smoke Management System:</b>				
	A	Basements	NA	NA	NA
	B	Upper floors	Required	Provided	MR
5	<b>Fire Extinguishers</b>				
	A	Total numbers	12 nos.	15 nos.	MR
	B	Types	CO <sub>2</sub> , ABC	CO <sub>2</sub> , ABC	MR
	C	ISI marking	Required	Provided	MR

<b>6</b>	<b>First Aid Hose Reel</b>			
A	Total no. at each floor	1 no.	1 no.	MR
B	Length of hose reel	30 m	30 m	MR
C	Nozzle diameter	5 mm	5 mm	MR
<b>7</b>	<b>Automatic Fire Detection and Alarm System (ADAS)</b>			
A	Type of detectors	NA	NA	NA
B	Location of main Panel	NA	NA	NA
C	Location of repeater panel	NA	NA	NA
D	Alternate power source	NA	NA	NA
E	Hooter's location	NA	NA	NA
<b>8</b>	<b>MOEFA</b>	NA	NA	NA
<b>9</b>	<b>Public Address System</b>	NA	NA	NA
<b>10</b>	<b>Automatic Sprinkler System</b>			
A	Basement	Required	Provided	MR
B	Upper floor	NA	NA	NA
C	Sprinklers above false ceiling	NA	NA	NA
<b>11</b>	<b>Internal hydrants</b>			
A	Size of the riser/down comer	NA	NA	NA
B	No. of hydrants per floor	NA	NA	NA
C	Hose box	NA	NA	NA
<b>12</b>	<b>Yard Hydrants</b>			
A	Total no. of hydrants	NA	NA	NA
B	Hose box	NA	NA	NA
<b>13</b>	<b>Pumping arrangements</b>			
A	<b>Ground Level</b>			
a)	Discharge & head of main pump	NA	NA	NA
b)	Number of main pump	NA	NA	NA
c)	Discharge & head of jockey pump	NA	NA	NA
d)	Discharge & head of Standby pump	NA	NA	NA
e)	Auto starting/ manual stopping	NA	NA	NA
B	<b>Terrace Level</b>			
a)	Discharge of terrace pump	220 LPM	450 LPM	MR
b)	Head of terrace pump	Required	Provided	MR
c)	Alternate power supply	Required	Provided	MR
d)	Auto starting of pump	Required	Provided	MR
<b>14</b>	<b>Captive Water Storage for Fire Fighting</b>			
A	Underground tank capacity	NA	NA	NA
B	Draw off connection	NA	NA	NA
C	Fire Service Inlet	NA	NA	NA
D	Access to tank	NA	NA	NA
E	Overhead tank capacity	2500 ltrs	5000 ltrs	MR
<b>15</b>	<b>Exit Signage</b>	Required	Provided	MR
<b>16</b>	<b>Provision of lift</b>			
A	Pressurization of lift shaft	NA	NA	NA
B	Pressurization of lift lobby	NA	NA	NA
C	Communication in lift car	NA	NA	NA
D	Fireman switch	NA	NA	NA
E	Lift signage	NA	NA	NA
<b>17</b>	<b>Standby Power Supply</b>	Required	Provided	MR

Lucknow Public School located at L-1, Kh. No-57/13/2, Asthal Mandir Marg, Sangam Vihar, New Delhi - 110044.


<b>18</b>	<b>Refuge Area</b>			
A	location	NA	NA	NA
B	Total area	NA	NA	NA
<b>19</b>	<b>Fire Control Room</b>			
A	Fire Detection System panel	NA	NA	NA
B	Flow switch panel	NA	NA	NA
C	P A system panel	NA	NA	NA
D	Battery backup	NA	NA	NA
E	Building floor plan	NA	NA	NA
<b>20</b>	<b>Special Fire Protection for special risk if any</b>			NA
A	Special Fire Protection system for Protection of Special Risk, if any:			NA

**LEGENDS:-Meeting Requirement (MR), Not Meeting Requirement (NMR), Not Applicable (NA), Provided but Not Functional (PNF), Not Provided (NP).**


Note: The name of the School has been changed from National Rajdhani Public School to J.N. International School and the building is now comprised of Ground + 03 upper floors but the School Management has submitted an undertaking stating that the School is operational only upto 1<sup>st</sup> floor.

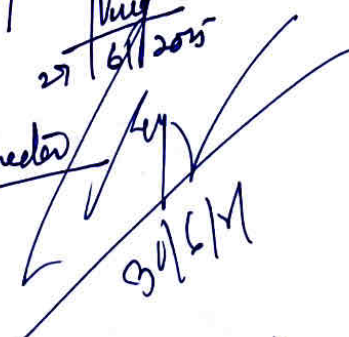
The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspections.


Keeping In view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the Rules, the FSC issued vide letter no F6/DFS/MS/School/2018/SZ/254 dated 15.02.2018 is recommended to be renewed under Rule 37 of the Delhi Fire Service Rules 2010.

  
 Signature of the Inspecting Officer  
 Name Rajesh Kumar Shukla  
 Designation ADO (M. Road)

DO (SD)  26/6/18

CFD/  25/6/2018

Director  25/6/18

 25/6/18