

E/40

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE

NEW DELHI- 110001

No. F.6/DFS/MS/EH/2026/SZ/726

Dated: 10/09/2026

FIRE SAFETY CERTIFICATE

Certified that the M/s. **Mardigras by Uncover (A unit of KIKI foods LLP)** Plot No. 231, Sec. 09, Dwarka, New Delhi- 110077, running at ground and first floor in a building comprised of basement, ground plus 02 upper floors, was issued FSC by this department vide letter F6/DFS/MS/SZ/2023/EH/223 dated 12.07.2023. The premises was re-inspected by the officer concerned of this department on dated 14.08.2026 in the presence of the Manager, and found that the building/premises is fit for occupancy class "D" "Assembly Building" (**Restaurant running at ground & 1st floor only**) w.e.f. 10/09/2026 with a period of three years, in accordance with Rule- 36 unless renewed under Rule- 37 or sooner cancelled under Rule- 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed below.

Issued on 10/09/2026 at New Delhi.


(A.K. Malik)
Chief Fire Officer
South Zone
9/9/26

Online application Id 2026072109989 dated 25.07.2026.

Copy to: - The Executive Engineer (Building), MCD, Civic Centre, Minto Road, New Delhi. : - to inform about use of basement and a request to ensure the occupancy as detailed above and deviation, if any.

Conditions for validity of Fire Safety Certificate:-

1. The FSC issued only for eating house/ restaurant running at ground & 1st floor only.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
3. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
4. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
5. The trained staff should be available round the clock.
6. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
7. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/14

INSPECTION REPORT

1.	Name & address of the building	Mardigras by Uncover (A unit of KIKI Foods LLP) at Plot No. 231, Sector- 9, Dwarka, New Delhi-110077		
2.	Type of Occupancy	Assembly 'D' Group		
3.	Building Comprised of	Basement (others property), Ground plus 02 upper floors (Restaurant running at Ground and 1st floor only)		
4.	Type of Case	Renewal		
5.	Details of previous FSC No.	F6/DFS/MS/SZ/2023/EH/223 dated 12.07.2023		
6.	Fire Safety directives Letter No.	NBC Part- IV		
7.	Date of inspection	14.08.2026		
8.	Name of the Inspecting Officer	R.K. Yadav, ADO (DWK)		
9.	Name and designation of Officer from the building side	Manager		
10.	Year of Construction	2010 (as per MCD online application)		
11.	Applicant's letter No.	Online Id 2026072109989 dated 25.07.2026		
Sr. No.	Minimum standards on fire prevention and fire safety U/R 33	As per NBC/UBBL	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6.0m	Provided	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02 Nos.	Provided	MR
	• Basements	N/A	N/A	Others property
	b. Width of staircases			
	• Upper floors	1.50 m each	Provided	MR
	• Basements	N/A	N/A	Others property
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	01 Nos.	Provided	MR
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	1.0 m	Provided	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke Managements System			
	• Basement.	N/A	N/A	N/A
	• Upper floors	12 a/c per hour	Natural Ventilation	MR
5.	Fire Extinguishers			
	• Total numbers	08 Nos.	Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• ISI marking	ISI marked	Provided	MR

N/15

6.	First-Aid Hose Reels			
	• Total numbers on each floor	01 nos.	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system.			
	• Type of detector	N/A	Provided	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down- comer	100 mm	Provided	MR
	• Number of hydrants per floor	01 nos.	Provided	MR
	• Hose Box	Required	Provided	MR
	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main pump	N/A	N/A	N/A
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Staring/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	400 LPM (450 LPM)	Provided	MR
	➤ Head of the pump	40 m	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water storage for firefighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	20,000 ltr	Provided	MR
15	Exit signage	Required	Provided	MR
16.	Provision of lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	Required	Provided	MR
	➤ Fireman's Grounding Switch	Required	Provided	MR
	➤ Lift Signage	Required	Provided	MR

N/16

17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of Special Risks, if any;	Required	Co2 fire extinguisher provided near electric panel	MR

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection. Shortcomings issued by this department vide letter No. F.6/DFS/MS/EH/2026/WZ/745 dated 30.07.2026 have been rectified.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter No. F6/DFS/MS/SZ/2023/EH/223 dated 12.07.2023, **renewal under rule 37** of the Delhi Fire Service Rules 2010, **is recommended.**

Signature of the Inspecting Officer
Name: -R.K. Yadav
Designation: - ADO (DWK)

DO (SW)

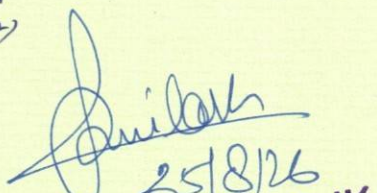

19/8/26

Depto (WZ)


24/08/2026

Debabrata Mukherjee

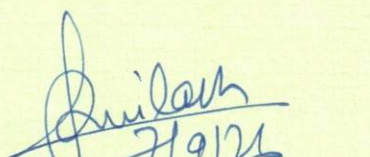
Cfo (WZ)


25/8/26
A.K. MALIK


Dr. Dis.

Cfo to Home. Mr.

Received on 7/9/26
Cfo (WZ)


7/9/26
A.K. MALIK

Dr. Oad (WZ)
20/9/26


20/9/26
A.K. MALIK