

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE**

**NEW DELHI-110 001.**

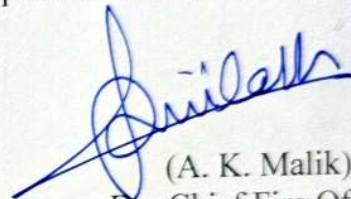
No. F.6/DFS/MS/School/2025/SZ/ 1402

Dated: 19/12/2025

**FIRE SAFETY CERTIFICATE**

Certified that the New Delhi Convent Senior Secondary School located at RZH- 121, Raj Nagar- II, Palam Colony, New Delhi- 110045. building comprised of ground plus three upper floors, owned/occupied by New Delhi Convent Senior Secondary School. The school building was inspected by the officer concerned of this department on dated 12.12.2025 in the presence of Ms. Maya Devi (Manager), and found that the school building have complied with the fire prevention and fire safety requirements in accordance with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises (ground plus three upper floors) is fit for occupancy class B "Educational Building" with effect from 19/12/2025 for a period of three years in accordance with the Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 19/12/2025 at New Delhi.

  
(A. K. Malik)  
Dy. Chief Fire Officer  
South Zone  
9cy.

Copy to:-

1. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi – 110054.
2. The Manager, New Delhi Convent Senior Secondary School located at RZH- 121, Raj Nagar- II, Palam Colony, New Delhi- 110045.

**Conditions for validity of fire safety certificate: -**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

# INSPECTION REPORT

- |   |   |  |
|---|---|--|
| 1. Name & address of the building                             | : | New Delhi Convent Sr. Sec. School at RZH-121, Raj Nagar- II,<br>Palam Colony, New Delhi- 110045. |
| 2. Building is comprised of                                   | : | Ground plus three upper floors   |
| 3. Type of Occupancy  | : | Educational  |
| 4. Type of Case   | : | New Case   |
| 5. Details of Previous FSC                                    | : | N/A  |
| 6. Fire Safety directives letter No                           | : | N/A  |
| 7. Date of inspection   | : | 12.12.2025   |
| 8. Name of Inspecting Officer                                 | : | A.D.O. R.K. Yadav  |
| 9. Name and designation of officers<br>From the building side | : | Ms. Maya Devi (Manager)  |
| 10. Year of Construction                                      | : | Before- 1989   |
| 11. Applicant's letter No.                                    | : | NUCS/Fire/Nov/2438 dated 17.11.2025  |

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement <i>NBC/UBBL</i>	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	Accessible 06 m 4.5 m N/A	Provided Provided N/A	MR MR N/A
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floors</li> <li>• Basements</li> </ul>	02 nos. N/A	04 nos. N/A	MR N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basements</li> </ul>	1.50 m each N/A	1.80, 1.50, 1.20 & 0.85 m N/A	MR N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	N/A 02	N/A 02	N/A MR
	d. No. of continuous staircases to terrace	1.50 m	2.50 m	MR
	e. Width of Corridor	1.0 m	1.0 m	MR
	f. Door Size			
3.	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	N/A Required	N/A Natural ventilation provided	N/A MR
5.	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	20 no's ABC/CO <sub>2</sub> type ISI marked	Provided Provided Provided	MR MR MR
6.	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	01 Nos. 30 m 5 mm	Provided Provided Provided	MR MR MR

N/18

7.	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Ground Floor</li> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	100 mm	Provided	MR
		01	Provided	MR
		01	Provided	MR
12.	<b>Yard Hydrants</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
13.	<b>Pumping Arrangements</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/Manual Stopping</li> </ul> </li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Pump House Access</li> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	N/A	N/A	N/A
		450 LPM	450 LPM × 2	MR
		40 M	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14.	<b>Captive Water Storage for fire-fighting</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity <ul style="list-style-type: none"> <li>Draw-off connection</li> <li>Fire service inlet</li> <li>Access to tank</li> </ul> </li> <li>Overhead Tank capacity</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		10,000 ltrs.	10,000 ltrs	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts. (No Lift)</b>			
	<ul style="list-style-type: none"> <li>Pressurization of Lift Shaft</li> <li>Pressurization of Lift lobby</li> <li>Communication In lift Car</li> <li>Fireman's Grounding Switch</li> <li>Lift Signage</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17.	<b>Standby power supply</b>	Required	Provided	MR

N/S

Refuge Area.			
9.	Total Area Location	N/A	N/A
		N/A	N/A
9.	Fire Control Room	N/A	N/A
		N/A	N/A
		N/A	N/A
		N/A	N/A
		N/A	N/A
		N/A	N/A
10.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A
		N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection. The shortcomings was issued by this department vide letter No. F.6/DFS/MS/School/2020/SZ/681 dated 15.10.2020 have been rectified.

Keeping in view the compliance of the minimum standards on fire prevention and fire safety required under the rules it is **recommended to grant Fire Safety Certificate** under Rule 35 of the Delhi Fire Service Rule 2010.

*R.K. Yadav*  
 Signature of the Inspecting Officer  
 Name: - R.K. Yadav  
 Designation: - ADO (DWK)

~~DO (SW)~~  
*[Signature]*  
 15/12/20  
**RAJINDER ATWAL**  
 Dy. CFO (SZ)

~~*[Signature]*~~  
**A.K. MALIK**  
 Principal Director

*[Signature]*  
 Dy. CFO to Secy.  
 16/12/20

~~*[Signature]*~~  
**A.K. MALIK**  
 Dy. CFO (SZ)

~~DO (SW)~~  
 17/12  
 ADO - Dy. CFO