



No. F.6/DFS/MS/2026/CZ/ 207

Dated: 09 / 09 /2026

FIRE SAFETY CERTIFICATE

Certified that Property No. 9, Located plot No. 09, South Patel Nagar, New Delhi-110005, comprised of Basement, Stilt, Ground plus 03 upper floors owned/ occupied by Mr. Rahul Malik, have complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of Delhi Fire Service in the presence of Mr. Harish Khurana (Caretaker) on 23/07/2026, and that the premises is fit for occupancy class **"Mixed Group-B & E (Educational & Business building)"** (basement – vacant, Stilt - parking, GF- bank, 1st - coaching centre & office, 2nd - reading room and 3rd - coaching centre), with effect from 09 / 09 /2026 for a period of **three years** in accordance with rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 09 / 09 /2026 at New Delhi by.


8/9/26

(Dr. S.K. Tomar)
Chief Fire Officer
Delhi Fire Service

Copy to: -

1. The Dy. Commissioner, MCD, Desh Bandhu Gupta Road Dev Nagar, Karol Bagh New Delhi-110005.
(Ref. MCD Portal ID No Request ID. 70000357 dated 04/07/2026).
2. Mrs. Roopa Malik w/o Rahul Malik, Plot No. 9, South Patel Nagar, New Delhi-110005.

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all times as seen during inspection.
3. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
4. All the staff members must know the correct method of operation of fire-fighting system.
5. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."
8. Basement was lying vacant at the time of inspection the local/licensing authority shall ensure the use of building as per approved and completion plans only.

INSPECTION REPORT				
1	Name & Address of the Building	Plot No. 9 South Patel Nagar, New Delhi-110008.		
2	Type of Occupancy	Mixed (Business + Educational)		
3	Building comprised of	Basement, Stilt, Ground + 3 Upper Floor (using basement laying vacant, still as parking, GF as bank, 1 st as coaching centre & office, 2 nd reading room and 3 rd as coaching centre.		
4	Type of Case	New case		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F6/DFS/MS/BP/2025/316 dated 22/09/2025		
7	Date of Inspection	23/07/2026		
8	Name of the Inspecting Officers	Vinay Kumar (ADO/Patel Nagar)		
9	Name & Designation of Officers from the building side	Mr. Harish Khurana (Caretaker)		
10	Year of construction	2025		
11	Applicant letter No.	Outdoor diary 1649 dated 27/05/2026 and Request ID. 70000357 dated 04/07/2026		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	UBBL-2016 /NBC Requirement	Provided at Site	Remarks
1	Access to Building.			
	• Road width	06m	Provided	MR
	• Gate width	05 m	Provided	MR
	• Width of internal road	NA	NA	-NA-
2	Number, width, type & arrangement of exits			
	a. Number of Staircase			
	• Upper floors	02 Nos.	Provided	MR
	• Basement floor	02 Nos.	Provided	MR
	b. Width of Staircase			
	• Upper floors	1.50 m	2 m & 1.5 m	MR
	• Basement floor	1.50 m	2 m & 1.5 m	MR
	c. Protection of exits			
	• Fire check door	Required	Provided as per building plans	MR
	• Pressurization	NA	N/A	NA
	d. No. of continuous staircase to terrace	02 Nos.	Provided	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1.50 m	Provided	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided as per building plans	MR
	• Sealing of electrical shafts.	Required	Sealed	MR
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4	Smoke Management system.			
	• Basement	Required	Exhaust Fans Provided	MR
	• Upper floors	Required	Exhaust Fan Provided	MR
5	Fire Extinguishers.			
	• Total numbers	Required	Provided 24 nos.	MR
	• Types	ABC/CO2	ABC/CO2	MR
	• ISI Marking	ISI marked	Provided	MR

(Handwritten signature)

6	First Aid Hose Reels.			
	• Total numbers on each floor.	01 no.	Provided	MR
	• Length of hose-reel hose.	30 m	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR
7	Automatic fire detection & alarming system.			
	• Type of detectors	NA	Provided	NA
	• Location of Main Panel	NA	Provided at GF	NA
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	NA	NA	NA
	• Hooter's location	Required on each floor	Provided	MR
8	MOEFA	Required	Provided	MR
9	Public Address System	NA	N/A	N/A
10	Automatic Sprinkler System			
	• Basement & Stilt	Required	Provided	MR
	• Upper floors	NA	Provided	NA
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants.			
	• Size of Riser/Down-comer	100 mm	Provided	MR
	• Number of Hydrant per floor	01 no.	Provided	MR
	• Hose box.	01 no.	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	2280 LPM	Provided	MR
	➤ Head of main pump.	80 Mtrs.	Provided	MR
	➤ Number of main pumps.	1 No.	Provided	MR
	➤ Jockey Pump output.	180 LPM	Provided	MR
	➤ Jockey Pump head.	80 Mtrs.	Provided	MR
	➤ Standby Pump output.	2280 LPM	Provided	MR
	➤ Standby Pump head.	80 Mtrs.	Provided	MR
	➤ Auto Starting / Manual Stopping.	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace Level			
	➤ Discharge of pump.	900 LPM	Provided	MR
	➤ Head of pump.	40 Mtrs.	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	1,50,000 Ltrs.	Provided	MR
	➤ Draw-off connection.	Required	Provided	MR
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	10,000 Ltrs.	Provided	MR
15	Exit Signage.	Required	Provided	MR


N/12

16	Provision of Lifts.			
	- Pressurization of lift shaft. - Pressurization of lift lobby.	NA	NA	NA
	- Communication in lift car. - Fireman's switch. - Lift signage.	Required	Fire curtain Provided as per plans	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			
	- Total area - Location	N/A	N/A	N/A
		N/A	N/A	N/A
19	Fire Control Room.			
	- Detector System Panel. - Flow Switch Panel. - PA system Panel. - Battery backup - Building floor plan	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
20	Special Fire Protection System for the Protection of special Risk, if any:	N/A	N/A	N/A

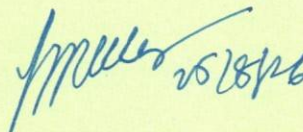


The Fire protection systems provided in the building were randomly checked and found functional at the time of inspection.

Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the Rules, **it is recommended to grant Fire Safety Certificate** under Rule 35(3) of the Delhi Fire Service Rules, 2010.

Accordingly, DFA is put up for approval and signature please.


Signature of the Inspecting Officer
Vinay Kumar
ADO (Patel Nagar)

DO(CD)


Principal Director
CFO to issue

22/8/20
CFO (E&A)

21/8/20
ADDP
P.T.O