

22

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

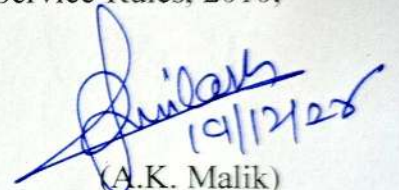
No. F6/DFS/MS/School/SZ/2025/1409

Dated: 22/12/2025

FIRE SAFETY CERTIFICATE

Certified that Shri Nijatam Prem Vidyalaya located at 17/52, Anand Parbat, New Delhi- 110005, comprised of basement (storage), ground plus two upper floor, was granted Fire Safety Certificate vide letter No. F.6/DFS/MS/School/SZ/2022/1199 dated 31.10.2022. The school building was re-inspected by the officer concerned of this department on dated 10.12.2025 in the presence of Mrs. Manjeet Kaur, Principal of the school and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules 2010 and that the school building is fit for occupancy class "Educational" (Basement, Ground plus Two upper floors only) with effect from the date of issue of this certificate for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 22/12/2025 at New Delhi by.


(A.K. Malik)
Dy. Chief Fire Officer
South Zone

Copy to: -

1. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054.
2. The HOS, Shri Nijatam Prem Vidyalaya at 17/52, Anand Parbat, New Delhi- 110005.
3. The Executive Engineer (Bldg.), MCD, Civic Centre, New Delhi.

:- for information regarding use of basement.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. Basement shall be used as per NBC/UBBL. Presently basement use for storage only.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

1. Name & address of the building	:	Shri Nijatam Prem Vidyalaya, 17/52, Anand Parbat, New Delhi- 05
2. Type of Occupancy	:	Educational
3. Building Composition	:	School building comprised of basement, ground plus two upper floors.
4. Type of Case	:	Renewal
5. Details of previous NOC	:	F.6/DFS/MS/School/SZ/2022/1199 dated 31.10.2022
6. Fire Safety directives letter No	:	N/A
7. Date of inspection	:	01.12.2025
8. Name of the Inspecting Officers	:	ADO R.K. Yadav (SRD)
9. Name and designation of officers from the building side	:	Mrs. Manjeet Kaur, Principal
9. Year of Construction	:	Before 1980
10. Applicant's letter No.	:	Form "J" dated 22.09.2025

Sr. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement as per FSC dt. 31.10.2022	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02 Nos.	02 Nos.	MR
	• Basements	02 Nos.	02 Nos.	MR
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.5 m or less & 0.75 m	1.20 & 0.90 mts	MR, old case
	• Basements	1.5 m or less & 0.75 m	1.10, 2.10 mts	MR, old case
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	02	02	MR
	g. Width of Corridor	Old case	1.33 mts.	MR, old case
	h. Door Size	Old case	0.95 mt.	MR, old case
3	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	Sealed	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	Smoke Management System.			
	• Basements	30 a/c per hour	Exhaust fan provided	MR
	• Upper floors	12 a/c per hour	Natural ventilation	MR
5	Fire Extinguishers			
	• Total numbers	21 nos.	Provided	MR
	• Types	ABC, CO ₂ type	Provided	MR
	• IS marking	ISI marked	Provided	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR

M/D

7	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	Required	Provided (62.5 KVA)	MR
	• Hooters' Location	N/A	N/A	N/A
8	MOEFA	N/A	N/A	N/A
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• Size of riser/down-comer	N/A	100 mm	N/A
	• Number of hydrants per floor	N/A	01 No.	N/A
	• Hose Box	N/A	01 No.	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	01 No.	N/A
	• Hose Box	N/A	01 No.	N/A
13	Pumping Arrangements			
	• Ground Level	---	----	-----
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level	----	-----	-----
	➤ Discharge of pump	900 LPM	900 LPM	MR
	➤ Head of the pump	40 mts	40 mts	MR
	➤ Power Supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	Provided	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	Old case	5000 lts	MR, old case
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts. Not Applicable			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided (62.5 KVA)	MR

