

c 44

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE

NEW DELHI-110 001.

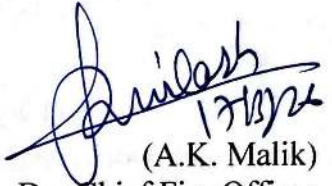
No. F.6/DFS/MS/School/2026/SZ/ 37

Dated: 18/03/2026

FIRE SAFETY CERTIFICATE

Certified that the St. Michell Public School located at B Block, Bindapur, Janak Puri, New Delhi-110059, running at ground, 1st, 2nd & 3rd floor in a building comprised of basement, ground plus four upper floors (basement is not in use & 4th floor is completely closed), owned/occupied by St. Michell Public School. The school building was inspected by the officer concerned of this department on dated 23.02.2026 in the presence of Sh. Rahul Nath Goswami (Manager), and found that the building/ premises is fit for occupancy class B "Educational Building" (for ground, 1st, 2nd & 3rd floor only) with effect from 18/03/2026 for a period of three years in accordance with the Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010, printed below.

Issued on 18/03/2026 at New Delhi.


(A.K. Malik)
Dy. Chief Fire Officer
South Zone
9/9

Copy to:-

1. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi – 110054.
2. The Chairman, St. Michell Public School located at B Block, Bindapur, Janak Puri, New Delhi-110059.
3. The Executive Engineer (Bldg.), MCD, Civic Centre, New Delhi.

: - for information regarding use of basement.

Conditions for validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. Presently basement is vacant and not use for any purpose.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
9. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/8

INSPECTION REPORT

1. Name & address of the building : St. Michell Public School at B-Block, Bindapur, Janak Puri, N.D- 59
 2. Type of Occupancy : Educational
 3. Building comprised of : Basement (vacant), ground floor, 1st, 2nd & 3rd floor (School) & 4th floor is completely closed.
 4. Type of Case : New
 5. Details of Previous NOC : N/A
 6. Fire Safety directives letter No : N/A
 7. Date of inspection : 23.02.2026
 8. Name of Inspecting Officer : A.D.O. R.K.Yadav (DWK)
 9. Name and designation of officers
 From the building side : Dr. Rahul Nath Goswami (Manager)
 10. Year of Construction : Before 1997 (as per Director of education recognition letter)
 11. Applicant's letter No. : Letter No. SMPS/2025/FNOC/005, dated 13.08.2025

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirements	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 06 m 4.5 m N/A	06 m Directly accessible from road N/A	MR MR N/A
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	02 No's 02 No's	02 No's 02 No's	MR MR
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.50 & 0.75 m 1.50 & 0.75 m	1.45 to 1.50 m & 0.80 to 0.90 m 1.45 to 1.50 m & 1.50 m	MR MR
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	01 No's	Provided	MR
	e. Width of Corridor	N/A	N/A	N/A
	f. Door Size	1.0m	Provided	MR
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	12 ACPH 12 ACPH	Exhaust fan provided Natural ventilation	MR MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers on each floor Types IS marking 	15 no.'s ABC/CO ₂ type ISI marked	Provided Provided ISI marked	MR MR MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	01 no's 30 m 5 mm	Provided Provided Provided	MR MR MR

MS

7.	Automatic fire detection and alarming system			N/A
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	MR
8.	MOEFA	Required	Provided	N/A
9.	Public Address System	N/A	N/A	
10.	Automatic Sprinkler System			Basement closed
	<ul style="list-style-type: none"> Basement Ground Floor Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants			N/A
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12.	Yard Hydrants			N/A
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/Manual Stopping 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
	<ul style="list-style-type: none"> Pump House Access 	N/A	N/A	N/A
	<ul style="list-style-type: none"> Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 	450 LPM	Provided	MR
		40 m	40 m	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> Underground tank capacity <ul style="list-style-type: none"> Draw-off connection Fire service inlet Access to tank Overhead Tank capacity 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		10,000 ltrs	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			No Lift
	<ul style="list-style-type: none"> Pressurization of Lift Shaft Pressurization of Lift lobby Communication In lift Car Fireman's Grounding Switch Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A

MS

M10

17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection. The shortcomings was issued by this department vide letter No. F6/DFS/MS/School/2025/SZ/519 dated 10.06.2025 (placed at C-23) have been rectified.

Note: - As per affidavit submitted by the school management (placed at C- 40) the school building comprised of basement, ground plus 04 upper floors, using basement (vacant and not in use), ground floor (office), 1st, 2nd & 3rd floor (each floor having 06 classroom) and 4th floor of the premises is completely sealed and not in use for any purpose. The height of the building is 14.93 m and verified by an MCD approved engineer (height certificate and MCD certificate of engineer is attached).

Keeping in view of the above compliance of the minimum standards of fire prevention and fire safety measures under Rule 35 of the Delhi Fire Service Rules 2010, **it's recommended to grant Fire Safety Certificate.**

R.K. Yadav
 Signature of the Inspecting Officer
 Name- R.K. Yadav
 Designation- ADO (DWK)

DO (South West)

Rajinder Atwal
 12/3/26
 RAJINDER ATWAL
 DfS (S2)

A.K. Malik
 12/3/26
 A.K. MALIK
 Principal Director

My. CFO to Secy.
[Signature]
 12/03/26

A.K. Malik
 14/3/26
 A.K. MALIK
 DO (S2)

[Signature]
 14/3
 ADO - SWK