

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No. F.6/DFS/MS/School/2025/SZ/21

Dated: 15/01/2025

**FIRE SAFETY CERTIFICATE**

Certified that the **Tagore International School**, located at **E- Block, East of Kailash, New Delhi-110065** comprised of Basement, Ground + Three Upper Floors owned/occupied by Tagore International School was issued FSC by this department vide letter No. F6/MS/DFS/School/2021/SZ/944 Dated 17-11-2021. The said premise was re-inspected by officer concerned of this department on 07/01/2025 in presence of Mr. Lalan Singh and found that the said school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No 262-362 dated 17/01/2005 issued by Director of Education, Govt. of NCT of Delhi and the building is fit for occupancy class "**Educational Building Group - B**" with effect from 15/01/2025 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules 2010.

Issued 15/01/2025 at New Delhi by

(ATUL GARG)  
DIRECTOR  
DELHI FIRE SERVICE

Copy to: -

1. The Principal, Tagore International School, E- Block, East of Kailash, New Delhi-65
2. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-54

**Conditions for the validity of Fire Safety Certificate: -**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The basement shall be used as per the provisions of BBL-/NBC Part- IV.
5. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
6. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
7. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry."

M/12


## INSPECTION REPORT

1	Name & Address of the Building	Tagore International School, E- block, East of Kailash, New Delhi-110065		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement (02 blocks) Ground + 03 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/MS/DFS/School/2021/SZ/944 Dated 17-11-2021		
6	Fire Safety Directives Letter No	DOE Circular dated 17/01/2005		
7	Date of Inspection	07/01/2025		
8	Name of the Inspecting Officers	Sh. Rajesh Kumar ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Lalan Singh		
10	Year of construction	1986		
11	Applicant letter No.	Outdoor diary no 10820 dated 30/12/2024		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1.	<b>Access to Building.</b>			
	• Road width	Required	12 mtr	MR
	• Gate width	Required	4.5 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
2.	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	04 Nos	06 Nos	MR
	➤ Basement floor.	02 + 05 Nos	1 <sup>st</sup> Blk- 03 Nos, 2 <sup>nd</sup> Blk- 05 Nos	MR
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.50 mtr	1.30m, 1.05m, 1.05m, 1.10 1.45, & 1.30m (Iron)	MR (old case)
	➤ Basement floor	1.50 mtr	1 <sup>st</sup> Blk- 1.5 & 1.5 & 1.18m 2 <sup>nd</sup> Blk- 1.3m, 1.70 & 1m x 3	MR (old case)
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	Required	Provided	MR
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1m	Provided	MR
3.	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	-NA-	-NA-
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	Required	40 Nos	MR
	• Types	ABC / CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	04 Nos	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR

m/13

<b>7.</b>	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
<b>8.</b>	<b>MOEFA</b>	-NA-	-NA-	-NA-
<b>9.</b>	<b>Public Address System</b>	-NA-	Provided	-NA-
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	• Basement	Required	Provided	MR
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
<b>11.</b>	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	Required	100 mm	MR
	• Number of Hydrant per floor	-NA-	04 Nos	-NA-
	• Hose box.	-NA-	04 Nos	-NA-
<b>12.</b>	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
<b>13.</b>	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	450 & 180 LPM (03 Nos each)	Provided	MR
	➤ Head of pump.	40 m each	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
<b>14.</b>	<b>Captive water storage for fire fighting.</b>			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	10,000 Ltrs each	Provided	MR
<b>15.</b>	<b>Exit Signage.</b>	Required	Provided	MR
<b>16.</b>	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
<b>17.</b>	<b>Standby Power Supply</b>	Required	Provided	MR
<b>18.</b>	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

n/114

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>			
	The fire protection systems provided in the premises were test checked at random and found functional at the time of inspection.			
	Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under Director of Education circular, the FSC issued vide letter No. F6/MS/DFS/School/2021/SZ/944 Dated 17-11-2021, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.			
	Accordingly DFA is put up for approval and signature please.			
				 Signature of the Inspecting Officer Name: Sh. Rajesh Kumar Design: ADO (BCP)

DO (SD)

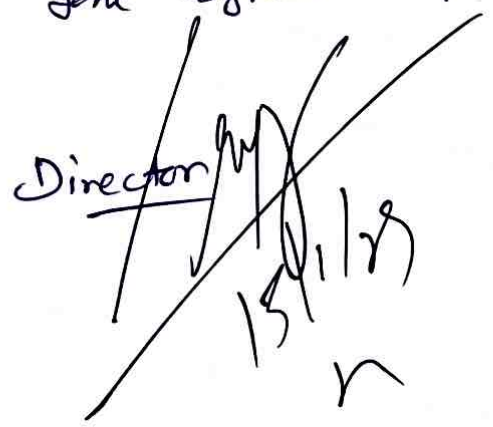
  
9/1/25

cto/dfs  
10/01/2025

  
ADY B/D

As approved, F-I letter is put up for  
gen signature PI

  
13/1/2025

Director  
  
15/1/25