



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110 001

No.F.6/DFS/MS/School/2025/NDZ/ 1417

Dated: 26/12/25

**FIRE SAFETY CERTIFICATE**

Certified that the Victor Public School located at Main Chowk Maujpur, Delhi-110053, comprised of ground plus three upper floors but school is running ground plus two upper floors only, owned/occupied by Victor Public School was issued FSC vide letter no. F.6/DFS/MS/School/2019/NDZ/616 dated 26/03/2019. The premises was re-inspected by the officer concerned of this department on 17/11/2025 in the presence of Sh. Deepak Kumar (Admin.) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with Circular No. 262-362 dated 17/01/2005 issued by the Director of Education and that the building/premises is fit for occupancy class 'Educational (Group-B)' (Ground plus two upper floors only) with effect from 26/12/25 for a period of **three** years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 & also conditions printed below.

Issued on .....26/12/2025... at New Delhi by

  
16/12/25

(Dr. S. K. TOMAR)  
DY. CHIEF FIRE OFFICER  
DELHI FIRE SERVICE

etc. p.

To,

The Manager, Victor Public School located at Main Chowk Maujpur, Delhi-110053

Copy:-

The Dy. Director of Education, B-Block, Yamuna Vihar, Delhi- 110092

**Conditions for the validity of Fire Safety Certificate**

1. FSC is valid for ground plus two upper floors only. 3<sup>rd</sup> floor which is sealed may not be used for any purpose failing which FSC should be treated null and void.
2. All the means of escape shall be kept free of all type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipment shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
6. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction /unauthorized use of land if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate of the Director in Form 'J' [sub rule (1) of rule (37)] along with a copy of this Certificate, Six Months prior to its expiry

1. Name & address of the building : Victor Public School Main Chowk,  
Maujpur, Delhi-110053
2. Building is comprised of : Ground plus three upper floors but school is running  
ground plus two upper floors only (3<sup>rd</sup> floor is sealed)
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC letter : F.6/DFS/MS/School/2019/NDZ/616 dt. 26/03/2018
6. Fire Safety direction letter No : Circular 262-362 dated 17/01/2005 issued by DoE
7. Date of Inspection : 17/11/2025
8. Name of the Inspecting officers : ADO (Shahdara), Deepak Kumar,
9. Name and designation of Officer  
from the building side : Sh. Deepak Kumar (Admin.).
10. Year of Construction : 2003-2004
11. Applicant's letter No : Email [maujpur@rediffmail.com](mailto:maujpur@rediffmail.com) dated 15/09/2025

Sr. No.	Minimum Standards on fire prevention and fire safety U/R33	DoE circular 2005 Requirement	Provided at Site	Remarks MR/NMR
01	Access to building			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	06 m N/A N/A	10 m N/A N/A	MR N/A N/A
02	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basement</li> </ul>	02 nos. N/A	03 nos. N/A	MR N/A
	B. Width of Staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basement</li> </ul>	1.50m / less than 1.50m an additional 0.75m N/A	02 no. 1.50 m & 1.20 m N/A	MR N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircases to terrace	02 nos.	02 nos.	MR
	e. Width of Corridor	1.50 m	1.50 m	MR
	f. Door Size	01 m	01 m	MR
03	Compartmentation.			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire rating of shaft door</li> <li>• Water curtain</li> <li>• Fire Dampers</li> </ul>	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
04	Smoke Management System.			
	<ul style="list-style-type: none"> <li>• Basement</li> <li>• Upper floor</li> </ul>	N/A N/A	N/A N/A	N/A N/A

05.	Fire Extinguishers			
	• Total numbers	06 nos.	16 nos.	MR
	• Types	ABC /CO <sub>2</sub>	ABC /CO <sub>2</sub>	MR
	• IS marking	ISI marked	ISI marked	MR
06	First-aid-Hose Reels.			
	Total numbers on each floor	01 No.	01 No.	MR
	• Length of hose reel hose	30 mtr	30 mtr	MR
	• Nozzle diameter	05 mm	05 mm	MR
07	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
08	MOEFA	N/A	N/A	N/A
09	Public address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	100 mm	100 mm	MR
	• Number of hydrants per floor	01 No.	01 No.	MR
	• Hose Box	01 No.	01 No.	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	N/A	N/A	N/A
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main Pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby pump out put	N/A	N/A	N/A
	➤ Standby pump Head	N/A	N/A	N/A
	➤ Auto Starting /Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the Pump	40 mtr	40 mtr	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR


N/17



14	Captive Water Storage for Fire Fighting.	N/A	N/A	N/A
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	5,000 Ltr	10,000 Ltr	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A


**Note:-** The school management has been submitted Affidavit, school is running ground plus two upper floors and 3<sup>rd</sup> floor is sealed and not being used for school and any purpose.

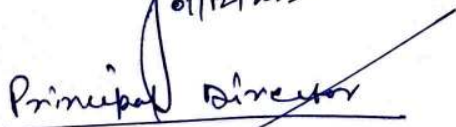
The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under DFS Rules 2010. The FSC issued vide letter no. F.6/DFS/MS/School/2019/NDZ/616 dated 26/03/2019 **renewal under rule 37 of the Delhi Fire Service Rule, 2010 is recommended.**

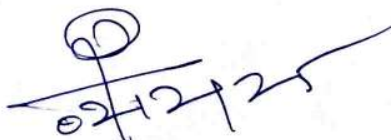
  
 Signature of the Inspecting Officer  
 Name :- Deepak Kumar  
 Designation :- A.D.O (Shd)

  
 D.O (FSC) .  27/11/20

  
 D.O (FSMA)  
 01/12/2023

  
 Principal Director

  
 D.O (NDZ)

  
 02/12/25

  
 3/12/25