



No. F6/DFS/MS/GH/NDZ/2025/153

Dated: 28/04/2025

FIRE SAFETY CERTIFICATE

Certified that the M/s Waves Restaurant (A Unit of Cuisine Craft Hospitality Pvt. Ltd.) located at A-4, Sarvodaya Enclave, Aurobindo Marg, New Delhi - 110017., building comprised of basement plus ground plus three upper floors, owned / occupied by M/s Waves Restaurant was granted FSC by this department vide letter No. F6/DFS/MS/EH/2022/SZ/103 dated 27/04/2022. The premises was re-inspected by the officer concerned of this department on 21/04/2025 in the presence of Mr. Hira Lal (Owner) & Mr. Naresh Chand (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Group - D "Assembly Building" (Restaurant running at ground floor only) with effect from 28/04/2025 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rule 2010. Subject to conditions printed below.

Issued 28/04/2025 at New Delhi by.

(ATUL GARG)
DIRECTOR

o/c DELHI FIRE SERVICE

Copy to: -

1. The Commission, MCD Civic Center, New Delhi: with a request to ensure the occupancy as detailed above.
2. The Joint Commissioner of Police (Lic.), first Floor, Police Station Defence Colony, New Delhi - 110024. w.r.t.- MCD portal ID - 2025040605723 dated 06/04/2025.
3. The Owner, M/s Waves Restaurant (A Unit of Cuisine Craft Hospitality Pvt. Ltd.) located at A-4, Sarvodaya Enclave, Aurobindo Marg, New Delhi - 110017.

Conditions for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry".

INSPECTION REPORT

1	Name & address of the building	M/s Waves Restaurant (A Unit of Cuisine Craft Hospitality Pvt. Ltd.) located at A-4, Sarvodaya Enclave, Aurobindo Marg, New Delhi - 110017.
2	Building is comprised of	Basement plus Ground plus Three Upper floors but Restaurant running at ground floor only.
3	Type of occupancy	Assembly "Group- D"
4	Type of case	Renewal
5	Details of previous FSC	F6/DFS/MS/EH/2022/SZ/103 dated 27/04/2022
6	Fire safety direction letter no.	Circular No. 4/22/2004/HP-III/356-359 dated 22/03/2005
7	Date of inspection	21/04/2025
8	Name of the inspecting officers	Yashwant Singh Meena, A.D.O / Laxmi Nagar
9	Name of the designation of officer From the building side	Mr. Hira Lal (Owner) & Mr. Naresh Chand (Manager)
10	Year of construction	2001
11	Applicant's letter no	MCD Portal application No. 2025040605723 dated 06/04/2025

S.No	Minimum Standards on fire Prevention and fire safety requirements U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR	
1	Access to building				
	a	Road width	0.6 mtrs	18 mtrs	MR
	b	Gate width	N/A	N/A	N/A
	c	Width of internal road	N/A	N/A	N/A
2	Number, Width, Type and Arrangement of Exits				
	A	Number of staircases			
		a	Upper floor	N/A	Restt. At GF only
	b	Basement	N/A	N/A	N/A
	B	Width of staircases			
		a	Upper floor	N/A	N/A
	b	Basement	N/A	N/A	N/A
	C	Protection of exits			
		a	Fire check door	N/A	N/A
	b	Pressurization	N/A	N/A	N/A
	D	No. of continuous staircases to terrace	01 no	Provided	MR
	E	Width of corridor	N/A	N/A	N/A
	F	Door size	2 Exits 1.5mtrs & 1.25 mtrs	1.50 mtrs & 1.25 mtrs	MR
	3	Compartmentation			
a		Fire check door	N/A	N/A	N/A
b		Sealing of electrical shafts	N/A	N/A	N/A
c		Fire rating of shaft door	N/A	N/A	N/A
d		Water curtain	N/A	N/A	N/A
e		Fire dampers	N/A	N/A	N/A
4	Smoke Management System				
	a	Basement	N/A	N/A	N/A
b	Upper floor	12 ACPH	Exhaust fan Provided	MR	

5.	Fire Extinguisher				
	a	Total numbers	05 nos.	05 nos.	MR
	b	Types	CO ₂ & ABC	CO ₂ & ABC	MR
	c	ISI marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.				
	a	Total numbers of each floor	01 no.	01 no.	MR
	b	Length of hose reel hose	30 mtrs	30 mtrs	MR
	c	Nozzle diameter	05 mm	05 mm	MR
7	Automatic Fire Detection & Alarming System.				
	a	Type of detectors CO Type	N/A	N/A	N/A
	b	Location of main panel	N/A	N/A	N/A
	c	Location of repeater panel	N/A	N/A	N/A
	d	Alternate source of power	N/A	N/A	N/A
	e	Hooter's location	N/A	N/A	N/A
8	MOEFA		Required	Provided	MR
9	Public Address System.		N/A	N/A	N/A
10	Automatic Sprinkler System.				
	a	Basement	N/A	N/A	N/A
	b	Upper floors	N/A	N/A	N/A
	c	Sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants				
	a	Size of riser/down-comer	N/A	100 mm	N/A
	b	Number of hydrants per floor	N/A	01 no	N/A
	c	Hose Box	N/A	01 no	N/A
12	Yard Hydrants.				
	a	Total number of hydrants	N/A	N/A	N/A
	b	Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.				
	A	Ground Level			
	a	Discharge of main Pump	N/A	N/A	N/A
	b	Head of Main Pump	N/A	N/A	N/A
	c	Number of main pumps	N/A	N/A	N/A
	d	Jockey pump out put	N/A	N/A	N/A
	e	Jockey pump head	N/A	N/A	N/A
	f	Stand by pump out put	N/A	N/A	N/A
	g	Stand by pump head	N/A	N/A	N/A
	h	Auto starting /manual stopping	N/A	N/A	N/A
	B	Terrace Level			
	a	Discharge of pump	225 LPM	450 LPM	MR
	b	Head of the Pump	28 mtrs.	40 mtrs.	MR
	c	Power supply	Required	Provided	MR
	d	Auto Starting of pump	Required	Provided	MR

11/29

M/s Waves Restaurant (A Unit of Cuisine Craft Hospitality Pvt. Ltd.) located at A-4, Sarvodaya Enclave, Aurobindo Marg, New Delhi - 110017.

14	Captive Water Storage for Fire Fighting			
	a	Underground tank capacity	N/A	N/A
	b	Draw-off connection	N/A	N/A
	c	Fire service inlet	N/A	N/A
	d	Access to tank	N/A	N/A
	e	Overhead Tank capacity	2500 liters.	5000 liters.
15	Exit Signage.		Required	Provided
16	Provision of Lifts			
	a	Pressurization of Lift Shaft	NA	NA
	b	Pressurization of Lift lobby	NA	NA
	c	Communication in lift car	NA	NA
	d	Firemen's switch	NA	NA
	e	Lift Signage	NA	NA
17	Standby power supply		Required	Provided
18	Refuge Area.			
	a	Total area	NA	NA
	b	Location	NA	NA
19	Fire Control Room			
	a	Detector system panel	N/A	N/A
	b	Flow switch panel	N/A	N/A
	c	PA system panel	N/A	N/A
	d	Battery backup	N/A	N/A
	e	Building Floor Plans	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:			N/A

The fire protection system was randomly checked and tested and was found functional at the time of inspection.

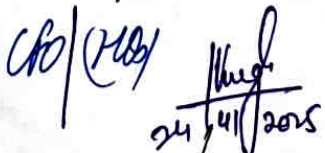
Keeping in view the compliance of the minimum standards of fire prevention and fire safety measures as required under the rules. The FSC issued vide letter no. F6/DFS/MS/EH/2022/SZ/103 dated 27/04/2022 renewal under rule 35(6) of the Delhi Fire Service rules 2010 is recommended.


22/4/2025

Signature of the Inspecting Officer
Name: Yaswant Singh Meena
Designation: ADO /Laxmi Nagar

D.O/SD

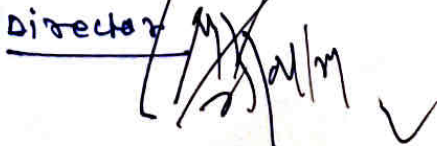

24/4/2025


24/4/2025


25/4/25

Six.

F.T Letter is out for sign. Pleasly


25/4/25


29/4/25


25/4/2025